



# 10TH STREET S.E. DRAINAGE IMPROVEMENTS PROJECT

## BID AND CONTRACT DOCUMENTS VOLUME 2: TECHNICAL SPECIFICATIONS

SOUTHERN SANDOVAL COUNTY ARROYO FLOOD  
CONTROL AUTHORITY (SSCAFCA)

IFB 2021-02

SSCAFCA PROJECT NUMBER: CA-P0014

April 2021

## List of Specifications

<b>Specification</b>	<b>Description</b>	<b>Notes</b>
APWA 701	Trenching, Excavation, and Backfill	For utilities
APWA 910	Storm Sewer Pipe Installations	
APWA 920	Sanitary and Storm Sewer Manholes	
APWA STD. DWG. 2102	Sewer Manhole Type "E"	
APWA STD. DWG. 2205	Drainage Storm Inlet Double "C"	
STS 1504	NPDES Compliance	

## SECTION 701

### TRENCHING, EXCAVATION AND BACKFILL

#### 701.1 GENERAL

Trench excavation and backfill for underground utilities, sanitary sewer, storm sewer, water lines, and appurtenances shall conform to these specifications or as specified in the Supplemental Technical Specifications or as authorized, in writing, by the ENGINEER.

#### 701.2 REFERENCES

##### 701.2.1 ASTM:

D-422 D-698  
D-1557 D-2321  
D-2487 D-2922  
D-3017 D-4318

##### 701.2.2 This Publication:

Section 207  
Section 301  
Section 302  
Section 336  
Section 337  
Section 340

#### 701.3 TERMINOLOGY

701.3.1 For the purpose of these specifications in this Section, the descriptive terms "flexible," "plastic" and "non-rigid" are similarly interchangeable as utilized in these specifications and appurtenant reference material.

701.3.2 Rigid pipe: shall be reinforced concrete, concrete cylinder, and vitrified clay pipes.

701.3.3 Flexible pipe shall be polyvinyl chloride, polyethylene, ductile iron, and corrugated metal pipes.

701.3.4 Standard Detail Drawings show the trench cross-sections which identify the meaning and limits of terminology used in these specifications for the terms "foundation, bedding, haunching, initial backfill, final backfill, embedment, pipe zone, cover, springline, and pipe width."

701.3.5 The Unified Soil Classification System in ASTM D2487 Shall be utilized for the purpose of

material classifications. See Table 701.3.A for a listing of referenced soil classes.

#### 701.4 NOTIFICATION OF FORTHCOMING WORK

701.4.1 To assure that the construction work progresses in a timely manner and that good public relations are maintained with the property owners, the following actions are considered essential:

701.4.1.1 Prior to the start of construction the CONTRACTOR shall assist the ENGINEER in notifying the adjacent property owners as to when construction will start, the estimated completion date, anticipated access blockages.

TABLE 701.3.A  
EMBEDMENT SOILS CLASSIFICATIONS

SOILS CLASS	SOIL TYPE	DESCRIPTION
CLASS I SOILS*		Manufactured angular, granular material, ¼ to 1-1/2 inches (6 to 40 mm) size, including materials having regional significance such as crushed stone or rock, broken coral, crushed slag, cinders, or crushed shells, complying to the requirements of Class II soils.
CLASS II SOILS**	GW	Well-graded gravels and gravel-sand mixtures, little or no fines. 50% or more of coarse fraction retained on No. 4 sieve. More than 95% retained on No. 200 sieve. Clean.
CLASS II SOILS**	GP	Poorly graded gravels and gravel-sand mixtures, little or no fines. 50% or more of coarse fraction retained on No. 4 sieve. More than 95% retained on No. 200 sieve. Clean.
CLASS II SOILS**	SW	Well-graded sands and gravelly sands, little or no fines. More than 50% of coarse fraction passes No. 4 sieve. More than 95% retained on No. 200 sieve. Clean.
CLASS II SOILS**	SP	Poorly graded sands and gravelly sands, little or no fines. More than 50% of coarse fraction passes No. 4 sieve. More than 95% retained on No. 200 sieve. Clean.
CLASS III SOILS***	GM	Silty gravels, gravel-sand-silt mixtures. 50% or more of coarse fraction retained on No. 4 sieve. More than 50% retained on No. 200 sieve.
CLASS III SOILS***	GC	Clayey gravels, gravel-sand-clay mixtures. 50% or more of coarse fraction retained on No. 4 sieve. More than 50% retained on No. 200 sieve.
CLASS III SOILS***	SM	Silty sands, sand-silt mixtures. More than 50% of coarse fraction passes No. 4 sieve. More than 50% retained on No. 200 sieve.
CLASS III SOILS***	SC	Clayey sands, sand-clay mixtures. More than 50% of coarse fraction passes No. 4 sieve. More than 50% retained on No. 200 sieve.
CLASS IV SOILS	ML	Inorganic silts, very fine sands, rock flour, silty or clayey fine sands. Liquid limit 50% or less. 50% or more passes No. 200 sieve.
CLASS IV SOILS	CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays, Liquid limit 50% or less. 50% or more passes No. 200 sieve.
CLASS IV SOILS	MH	Inorganic silts, micaceous or diatomaceous fine sands or silts, elastic silts. Liquid limit greater than 50%. 50% or more passes No. 200 sieve.
CLASS IV SOILS	CH	Inorganic clays of high plasticity, fat clays. Liquid limit greater than 50%. 50% or more passes No. 200 sieve.
CLASS V SOILS	OL	Organic silts and organic silty clays or low plasticity. Liquid limit 50% or less. 50% or more passes No. 200 sieve.
CLASS V SOILS	OH	Organic clays of medium to high plasticity. Liquid limit greater than 50%. 50% or more passes No. 200 sieve.
CLASS V SOILS	PT	Peat, muck and other highly organic soils.

--	--	--

- \* Soils are as defined in ASTM D2487, except for Class I Soil which is defined in ASTM D2321
- \*\* In accordance with ASTM D2487, less than 5% passes No. 200 sieve.
- \*\*\* In accordance with ASTM D2487, soils with 5% to 12% passing No. 200 sieve fall in a borderline classification that is more characteristic of Class II than of Class III.

701.4.1.2 Prior to the start of trenching operations, including pavement cutting and removal, the CONTRACTOR should coordinate with the ENGINEER any problem areas and involving traffic control, access to private properties, stockpiling of excavated materials, and other utility conflicts.

701.4.1.3 The CONTRACTOR shall provide the ENGINEER with the name and telephone number of at least two contact persons during non-working hours.

701.5 TRENCH SAFETY

The CONTRACTOR shall be responsible for maintaining all trenches in a safe condition; thereby protecting the workers and the general public. Trench slopes and other protection shall be in accordance with applicable regulations such as the Department of Labor's Occupational Safety and Health Administration Standards 29CFR Part 1926, subpart P or any applicable amendments.

701.6 BRACING EXCAVATIONS

701.6.1 Excavation for pipe shall normally be by open unsupported trenches unless local conditions warrant trench bracing.

701.6.2 Excavations shall be braced and sheeted. to provide complete safety to persons working therein and bracing shall comply with applicable Federal (OSHA), State and local laws and ordinances. Support systems for trenches in excess of 20 feet deep and adjacent to existing improvement or subject to vibrations or ground water shall be in accordance with OSHA regulations. The CONTRACTOR shall be fully responsible for sufficiency and adequacy of bracing excavations with respect to work under construction and adjacent utility lines and private property.

701.6.3 If the soil conditions within the trench area require support, the CONTRACTOR may elect to use tight sheeting, skeleton sheeting, stay bracing, trench jacks, or movable trench shield to support the trench during pipe laying operations, such as: bedding preparation, pipe laying, backfilling of haunches and initial zone.

701.6.4 No sheeting shall be permitted to remain in the trench except when, in the opinion of the ENGINEER, field conditions or type of sheeting or methods of construction used by the CONTRACTOR, warrant the supports must remain. The ENGINEER may opt to have the lower portion (within the pipe zone) of the sheeting to remain. If the CONTRACTOR plans on removing the sheeting, he shall submit method to the ENGINEER for approval to treat the void created by the removal of the sheeting within the pipe zone and below.

701.6.5 When a movable trench shield is used, the trailing half of the shield should be notched to the height of the top of the pipe. This will allow the haunch area of the pipe to be compacted properly to the wall of the trench. If the trench shield is not notched, a subtrench shall be excavated for pipe installation such that the bottom of the trench shield does not enter the pipe zone.

701.7 DEWATERING

701.7.1 Trenching and pipe laying operations may encounter standing water or ground water which would preclude the proper placing of bedding, backfilling, and laying pipe. The water shall be removed by pumps and associated equipment, such as well points, to lower the water level. Dewatering shall continue for a minimum 24 hours after placement of any concrete.

701.7.2 Dewatering operations shall remove the water to achieve a stable foundation for pipe embedment and backfilling. The ENGINEER shall determine if adequate foundation has been attained. The ground water shall be lowered to a minimum depth of 6 inches below pipe grades. Should over excavation be necessary due to unsuitable foundation conditions, the ground water shall be additionally lowered as necessary.

701.7.3 The CONTRACTOR shall submit a plan for approval by the ENGINEER as to how and where the waste water will be disposed. Waste water will not be discharged into traffic and pedestrian lanes or onto private properties.

701.7.4 The CONTRACTOR shall obtain permit from the New Mexico State Engineer prior to commencing dewatering operations.

701.7.5 The CONTRACTOR shall also responsible for any adverse effect his dewatering operation has to private property, including providing temporary water to residences and/or business necessitated by the effect on private wells.

701.7.6 The CONTRACTOR shall arrange dewatering operation in a neat and orderly manner such that access to adjacent, properties is maintained, the discharge system does not leak and that any power generation complies with applicable noise limit regulations .

#### 701.8 REMOVAL OF EXISTING PAVEMENT SIDEWALK, AND DRIVEWAY

701.8.1 Existing concrete pavement, sidewalk, or driveway removed in connection with construction shall be replaced , neatly sawed edges. Cuts shall be neat and to true straight lines with no shatter outside the removal area. If a saw cut would fall within 30 inches of a construction joint, cold joint, expansion joint, or edge, the concrete shall removed and replaced to the joint or edge. Concrete sidewalk and/or driveway may removed so that a minimum of 30-inch square is replaced. If the saw cut would fall within 12 inches of a score mark, the score mark.

701.8.2 Existing bituminous pavement removed in connection with construction shall be cut with a saw, pavement break cutting wheel, or other suitable tool approved by the ENGINEER. Care shall taken to assure that the edge of removed pavement does not vary from a straight line more than 2 inches from r mean.

701.8.3 Saw cutting shall be 1-1/2 inches in depth or 1/4 the thickness of the pavement, sidewalk, or driveway, whichever is greater. All saw cuts or other scoring shall be made perpendicular to the surface of the material to be cut.

701.8.4 Any unnecessarily irregular breakage or cracking caused by the CONTRACTOR shall be removed and replaced by the CONTRACTOR without added expense to the OWNER.

701.8.5 The CONTRACTOR shall be responsible for the disposal of removed materials.

701.8.6 Saw cutting is required on all concrete or asphalt paving on State maintained streets or roads.

701.8.7 Paving cuts for manholes and valve boxes and other utility appurtenances shall be square and at dimensions specified the Standard Detail Drawings or on the construction plans.

#### 701.9 MAXIMUM LENGTH OF OPEN TRENCH

In developed areas, no more than 300 feet of trench shall be opened in advance of pipe laying operations. This distance may be reduced due to traffic control considerations. Backfilling shall begin as soon as pipe is laid and inspected and shall keep pace with the pipe laying. In advance of trenching operations in undeveloped areas, the CONTRACTOR shall submit in writing or on plans for the ENGINEER'S approval, the maximum length of trench that will be open at anyone time. Except by permission of the ENGINEER, the maximum length of open trench in anyone location where concrete structures are cast in -place will be that which is necessary to permit uninterrupted progress. Construction shall be pursued as follows: excavation, formwork, and setting of reinforcing steel, placing of floor slab, walls, and cover slab or arch shall follow each other without anyone of these operations preceding the next nearest operation by more than 200 feet. Failure by the CONTRACTOR to comply with the limitations specified herein or as may be specifically authorized by the ENGINEER may result in a written order from the ENGINEER to halt progress of the work until such time as compliance with this paragraph has been achieved and the work can be proceeded in an orderly sequence of operations.

#### 701.10 WIDTH OF TRENCHES

Trench widths will vary according to the type of pipe used, size of pipe, depth of trench, and soil conditions, The minimum width requirements, indicated below, are for proper laying, aligning and jointing of pipe as well as trench grading, bedding preparation, and backfilling.

701.10.1 TRENCH WIDTH FOR RIGID PIPE MATERIALS: Trench widths from bottom of pipe to a point 12 inches above the top of the pipe shall be kept to the practical minimum required for properly laying, aligning, grading, jointing, and backfilling of the pipe, but no less width than pipe outside diameter plus 16 inches. For stable soils which will stand a vertical cut, the maximum trench width at a point 12 inches above the top of pipe or at a point 5 feet above the bottom of the trench, whichever is less, shall be as follows:

701.10.1.1 The pipe outside diameter plus 2 feet for pipes 27 inches in diameter and smaller.

701.10.1.2 1.6 times the nominal diameter for pipes 30 inches in diameter or larger.

701.10.1.3 When soil will not stand vertical. the trench sides shall be sloped to provide not less than the outside diameter plus 16 inches at the pipe invert.

701.10.2 TRENCH WIDTH FOR NON-RIGID PIPES: The minimum clear width of the trench measured at the springline of the pipe should be 1 foot greater than the outside diameter of the pipe. The maximum clear width of the trench at a point 1 foot above the top of the pipe is equal to the pipe outside diameter plus 2 feet. If the maximum recommended trench width must be exceeded *or* if the pipe is installed in a compacted embankment, then pipe embedment should be compacted to a point of at least 2-1/2 pipe diameters from the side of the pipe or to the trench walls.

#### 701.11 ROCK EXCAVATION

701.11.1 Rock is defined as material which cannot be excavated without drilling and blasting. All stone or boulders less than 8 cubic feet in volume will be classified as earth; all larger boulders shall be classified as rock. If blasting is necessary to excavate such materials as shale, hardpan, soft sandstone, cemented gravel, or loose rock which normally can be classified as earth excavation, then this excavation shall be classified as rock excavation. Whenever a ledge of solid rock encountered with earth below it or where alternate layers of solid rock and earth occur, the earth shall be included in the allowance for rock when the thickness of the layer of earth is less than 12 inches, thus requiring it to be removed by blasting along with the ledges of rock. Blasting will be considered necessary when the soil and rock cannot be excavated at a rate of 50 cubic yards per hour by a competent operator with a back-hoe that has a minimum bucket curling force of 25,000 pounds (John Deere 690 or equivalent).

701.11.2 Whenever rock is encountered in the trench or elsewhere in any excavation required to be made, it shall be excavated to the line and grade as shown on the plans and within the limits described therein, unless otherwise authorized, in writing, by the ENGINEER.

701.11.3 For trenches, rock shall be excavated to a depth of 6 inches minimum below the outside bottom of the conduit except at points of rock and earth transitions at which points the rock shall be

excavated to a minimum of 12 inches below the outside bottom of the conduit as shown on the detail sheets for trench cuts and backfill of rock. Any depression in the bottom of the trench caused by overshoot and/or excavating and being 6 inches or greater in depth from a theoretical bottom of trench grade shall be filled to the theoretical bottom of the trench with select soils. The trench shall be backfilled with select backfill material to a point 1 foot above the top of the conduit. The remainder of the trench shall be backfilled as specified herein. The complete trench backfill from the bottom through to the top of the subgrade shall meet the compaction and/or moisture requirements as specified herein.

701.11.4 BLASTING: Suitable weighted covering or mats shall be provided to confine all materials lifted by the blasting within the limits of the trench and to prevent injury of persons or damage to property. Blasting shall be under the supervision of a person qualified and experienced in the use and handling of explosives. All blasting operations shall be done in accordance with applicable local, state, and federal laws, ordinances, and codes regulating the transportation, storage, and use of explosives. Forty-eight hours prior to blasting operations, the CONTRACTOR shall notify the local law enforcement agency.

#### 701.12 FOUNDATION

701.12.1 All pipe shall be bedded on a stable foundation in a trench which is completely free of water. The ENGINEER shall determine the adequacy of the foundation. Class V soils shall not be used as a foundation. If Class V soils are encountered at the bottom of the trench it shall be removed to the depth authorized by the ENGINEER and replaced with Class I, II or III soils.

701.12.2 Where an unstable foundation condition is encountered, it must be stabilized before laying pipe or alternative foundation methods utilized. The CONTRACTOR will be paid for foundation stabilization when required by the ENGINEER. Failure to notify the ENGINEER of an obvious unstable foundation condition prior to proceeding with placement of the pipe shall result in complete removal of the affected pipe, foundation stabilization, and replacement of the pipe at the CONTRACTOR'S expense.

701.12.3 Should the trench be inadvertently over-excavated below the foundation, the area of over-excavation shall be filled with select material in 6 inch lifts and compacted to a density of not less than 95 percent of maximum density, as determined by ASTM D 1557.

701.12.4 Unless specifically approved in writing by the ENGINEER, the CONTRACTOR shall not proceed with pipe embedment in a trench where water is present or the foundation is saturated. Adequate dewatering, as specified in Section 701.7, shall be utilized.

## 701.13 PIPE EMBEDMENT

### 701.13.1 GENERAL:

701.13.1.1 The class of bedding used for each pipe shall be as shown on the plans or as specified in the Supplemental Technical Specifications.

701.13.1.2 The CONTRACTOR may request a change in the class of bedding required on a pipe, if authorized by the ENGINEER, all increase in the cost of labor and materials required to include upgrading of the pipe class will be at the CONTRACTOR'S expense with no additional cost to the OWNER.

### 701.13.2 RIGID PIPE EMBEDMENT:

701.13.2.1 The trenches shall be excavated in conformance with the trench width requirements in Section 701.10 and 701.5.

701.13.2.2 Embedment material shall be Class I, II, III, or IV soils, or lean fill as specified in Section 207.

701.13.2.3 All soil in the embedment zone shall be placed in lifts not exceeding 8 inches in uncompacted depth, except that material along the side of the pipe shall not be placed above the springline until the haunch area of the pipe is adequately filled and sliced such that no voids remain.

701.13.2.4 All soil shall be compacted to a density not less than 90 percent of maximum density, as determined by ASTM D 1557. The CONTRACTOR shall take care to assure that the pipe is not damaged or misaligned during compaction of the embedment.

### 701.13.3 FLEXIBLE PIPE EMBEDMENT:

701.13.3.1 Proper placement of soils in the embedment zone is extremely important in achieving a satisfactory installation of flexible pipe. The CONTRACTOR shall be aware that the soil classes have differing requirements relative to embedment. There are also differing requirements for embedment in dry and wet conditions (wet conditions meaning that the embedment zone will be subject to ground water).

701.13.3.2 Embedment material shall be Class I, II, or III soils, or lean fill as specified in Section 207.

701.13.3.3 Embedment soil shall be placed in lifts not exceeding 8 inches loose depth. The haunch shall be properly compacted by hand tampers utilizing due caution such that the pipe is not damaged or misaligned. Mechanical tampers shall not be utilized directly over the pipe in the embedment zone.

701.13.3.4 The CONTRACTOR may utilize acceptable on site soils in the embedment area which are in conformance with these specifications. The CONTRACTOR has the option of importing a different soil, however, additional compensation will only be allowed if the on site soils are Class IV or V.

701.13.3.5 Class I soil shall comply with the requirements of Section 302, AGGREGATE BASE COURSE.

701.13.3.6 Class II and III soils shall be compacted to a density of not less than 95 percent of maximum density in the embedment area, as determined by ASTM D 1557. The moisture content shall not exceed 5 percent above optimum.

## 701.14 FINAL BACKFILL

701.14.1 Final backfill shall consist of homogeneous soil except that boulders, frozen clumps, rubble, and Class V soils are excluded.

701.14.2 Final backfill shall be compacted to a density of not less than 90 percent of maximum density, as determined by ASTM D 1557 unless otherwise specified in the Contract Documents.

701.14.3 The upper portion of the final backfill may require specific soils and compaction in order to provide a suitable foundation for pavements, curb and gutter, sidewalk, or other type of structure.

## 701.15 COMPACTION METHODS

701.15.1 The CONTRACTOR shall be responsible for the compaction method utilized during foundation preparation, embedment placement, and final backfill except as otherwise specified herein or in the Supplemental Technical Specifications.

701.15.2 The use of mechanical vibratory compactors directly over the pipe is prohibited in the embedment area. Extreme care shall be taken when utilizing mechanical compactors in the haunch and initial backfill area in order to avoid damage to or misalignment of the pipe. The ENGINEER shall examine any damaged pipe and has the authority to



direct that it be replaced with new pipe at no additional cost to the OWNER.

701.15.3 Flooding or jetting shall be allowed if the subsurface soils are compatible to its usage, as authorized by the ENGINEER. It shall not be used for compaction of flexible pipe, when the soil has a plastic limit of 7 or greater, and in areas of collapsible soils. The CONTRACTOR shall take any necessary precautions to minimize to negligible flotation of the pipe.

701.15.4 The CONTRACTOR shall, at the direction of the ENGINEER, excavate the compacted fill as necessary for the purpose of determining the adequacy of the compaction.

## 701.16 PAVEMENT

701.16.1 Either new street construction or pavement replacements shall satisfy the following design and construction requirements:

701.16.1.1 Unless permanent pavement is specified to be placed immediately, a temporary dust-free patch shall be placed wherever excavation is made through existing pavements, sidewalks, or driveways. The patch shall be placed, rolled, and maintained by the CONTRACTOR to provide a smooth surface for traffic until a permanent pavement is constructed within the time frame specified by the ENGINEER.

701.16.1.2 The subgrade preparation of the area to be paved shall be in accordance with Section 301 of these specifications. The asphalt pavement placed shall be in accordance with Section 336 and the concrete pavement shall be in accordance with Section 337. The placement of the other roadway items shall be in accordance with Section 340.

701.16.1.3 Material thickness for all pavement replacements within residential or arterial streets shall conform to the plans or the Standard Detail Drawings or match the existing pavement as authorized by the ENGINEER.

701.16.1.4 Pavement cuts of 8 ft. or more in width and 100 ft. or more in length shall be paved with a laydown machine.

701.16.1.5 When authorized by the ENGINEER, asphalt concrete base course may be used to replace surface course thickness requirements on streets that are scheduled for overlay.

701.16.1.6 The edges of all trenches at the base course level shall be neatly trimmed before

beginning any paving replacement. All edges of the existing pavement adjacent to the trench cut shall be inspected. Undermined, broken, cracked, or unevenly cut portions shall be removed and the pavement edges retrimmed prior to pavement replacement. All vertical edges of the existing asphalt pavement adjacent to the trench cut and all surface areas for a width of at least 4 inches and no greater than 8 inches, shall be thoroughly cleaned and a tack coat applied prior to placing any hot mix asphalt. The finished surface of the pavement replacement shall be graded to conform to the existing contour both in cross section and profile.

701.16.1.7 Concrete pavement to replace cuts made in concrete paved streets, arterials, etc., shall conform to the Standard Detail Drawings for concrete pavement or in accordance with New Mexico Department of Transportation requirements where applicable.

701.16.1.8 When more than one-half of the surface area of a manhole, lamphole or valve box is found to extend into the area to receive a permanent asphaltic hot-mix surfacing and/or base pavement replacement, the existing pavement surrounding the manhole, lamphole, or valve box shall be removed to within those limits which will permit a permanent pavement replacement to be made in accordance with the approved plans.

701.16.1.9 Asphaltic hot mix shall not be placed upon the concrete collar, nor shall traffic be permitted upon the collar for at least 24 hours, or longer, if so directed by the ENGINEER. A tack coat of asphaltic emulsion may be applied after the concrete has taken its final set. During this time adequate barricading of the area shall be maintained by the CONTRACTOR.

701.16.1.10 If in the course of a pavement removal, a manhole, lamphole, and/or valve box is encountered and has a concrete collar about it and the collar is performing adequately, no special construction need be made in the permanent pavement replacement.

701.16.1.11 The CONTRACTOR shall make any small grade or alignment adjustment of the manhole, lamphole, and/or valve box encountered that is necessary to provide a smooth riding surface between the existing pavement and the patch and/or within the patch itself.

### 701.16.1.12 TESTING

701.16.1.12.1 A sample of each type of soil encountered shall be classified in accordance with

the requirements of ASTM D2487, and the moisture density relationship determined in accordance either ASTM D698 or D1557, whichever is applicable.

701.16.1.12.2 A compaction test shall be taken for each 2 feet depth per 200 feet trench length or less, as directed by the ENGINEER. Compaction tests shall be taken in accordance with ASTM D2922 and D3017. Areas represented by non-complying tests shall be reworked and re-tested for compliance.

#### 701.17 MEASUREMENT AND PAYMENT

##### 701.17.1 TRENCHING, BACKFILLING, AND COMPACTION:

701.17.1.1 Trenching, backfilling, and compaction shall be combined into one unit and shall be measured and paid for as follows:

701.17.1.2 Measurement shall be made along the centerline of the pipe.

701.17.1.3 The unit of measurement shall be by the linear foot *per* pipe diameter per specified increment of depth.

701.17.1.4 The following depth increments will apply:

701.17.1.4.1 For water line installations the costs for trenching, backfilling and compaction shall be included in the unit price per linear foot of pipe per pipe diameter for maximum depth, such as: 4 to 14 inch diameter at 6 feet, 16 to 24 inch diameter pipe at 7 feet and all pipe larger than 24 inch at 8 feet. Separate payment will be specified in the Bid Proposal when required depths exceed the above depths.

701.17.1.4.2 For sewer installations the increments shall be 8 feet or less, 8 feet to 12 feet, 12 feet to 16 feet, 16 feet to 20 feet and thereafter at 4 foot intervals.

701.17.1.4.3 All depths shall be measured to the nearest foot.

701.17.1.5 All depths shall be measured from the invert of the pipe to the top of existing ground elevation. The existing ground elevation shall be the elevation of the surface that exists along the centerline of the pipe at the time of construction staking for said trenching.

701.17.1.5.1 Whenever a special pipe embedment detail is specified, on the plans, the trench depth shall be measured from the bottom of the embedment to the top of existing ground elevation.

However, no additional trench depth shall be measured as a result of inadvertent over-excavation nor to accommodate trench dewatering.

701.17.1.6 Payment will be made at the unit price per linear foot per diameter of pipe per depth increment as specified in the Bid Proposal, and will include trenching, backfilling, and compaction for all trench zones. No additional payment will be made for compacted materials to bring trench backfill up to required depth.

701.17.2 OVER-EXCAVATION: Required over-excavation for foundation stabilization shall be measured by the cubic yard of material removed and replaced with compacted suitable material. Payment will be made at the unit price per cubic yard of compacted replacement material and shall include excavation, backfill material, and compaction.

701.17.3 ROCK EXCAVATION: Rock excavation will be measured by the cubic yard within the specified limits of the trench configuration. Blasting will be included in the rock excavation. Payment will be made at the unit price per cubic yard.

701.17.4 UNSUITABLE MATERIALS: Removal and disposal of unsuitable materials from the construction site shall be measured by the cubic yard of excavated material. Payment will be made at the unit price per cubic yard of excavated material.

701.17.5 PAVEMENT, SIDEWALK, AND DRIVEWAYS: Removal and disposal of existing pavement, sidewalks, and driveways will be measured by the square yard or square foot whichever is apropos. Payment will be made at the unit price per square yard or square foot as specified in the Bid Proposal.

701.17.6 SELECT MATERIALS: Where selected material is required in the backfilling operations, the quantity of material will be measured by the cubic yard of compacted material in place in the trench. Payment will be made at the unit price per cubic yard of select material as indicated above.

701.17.6.1 Whenever a special pipe embedment detail is specified, measurement and payment shall be as identified in the Bid Proposal.

701.17.7 DEWATERING: Dewatering operations for trench work shall be measured by the linear foot along the center-line of that portion of the trench which requires dewatering. Payment will be made at the unit price per linear foot of dewatered trench.

701.17.8 PAVEMENT:

701.17.8.1 Permanent or temporary pavement surfacing shall be measured and paid for in accordance with the paving section elements as defined under Section 300 for the specific item of work.

701.17.8.2 Permanent resurfacing or permanent surface patching will be measured on the basis of the square yard for new surfacing as provided in the applicable section of these specifications. For payment purposes, the normal maximum pavement cut width shall be as defined in the Table No. 701.17.8.2

TABLE No. 701.17.8.2

NORMAL MAXIMUM PAVEMENT CUT WIDTHS ALLOWED FOR PAYMENT PURPOSES

Soil Stability	Trench Depth (TD)	Pipe Size	Max. Pavement Cut Width
Stable. Soil stands in a vert. cut	Less than or equal to 5 feet	ND less than or equal to 27"	00 + 2 feet
"	Greater than 5'	ND less than or equal to 54"	TD + 2 feet
"	"	ND greater than 54"	1.6 X ND + TD + 3'
Unstable. Soil does not stand in vert. cut	Any	Any	2 X TD + OD

- NOTES: 1. TD is trench depth; ND is nominal pipe diameter; and OD is outside pipe diameter.
2. Individual locations or conditions may warrant greater cut widths than those specified above. The ENGINEER shall authorize in writing the increase in the above pavement cut widths.

SECTION 910

STORM SEWER PIPE INSTALLATIONS

910.1 GENERAL

910.1.1 The construction items, specified in this section, are common to storm sewer pipe installation and pipe type culverts.

910.1.2 Reinforced concrete pipe may be used for storm sewer pipe installations or pipe type culverts. Corrugated metal pipe will only be used for pipe-type culverts.

910.2 REFERENCES

910.2.1 ASTM

C 43	C 478
C 361	D 3034
C 425	F 679
C 443	

910.2.2 AWWA

C 603
-------

910.2.3 This publication per SECTIONS:

101	125
102	129
105	135
106	136
108	137
121	161
123	801
124	

910.3 MATERIALS

910.3.1 PIPE: Sewer line pipe and fittings shall be as specified in other sections, as follows:

Reinforced Concrete Pipe	Section 123
Reinforced Concrete Pressure Pipe	Section 124
Corrugated Metal Pipe and Arches	Section 135
Structural Plate for Pipe, Arches, and Pipe Arches	Section 136
Corrugated Aluminum Pipe and Arches	Section 137

910.4 CERTIFICATION

The OWNER/ENGINEER will be supplied with a certification on each item or type of material required in the sewer line, as to that item meeting the

specifications and/or the reference specifications before that item is installed.

910.5 INSTALLATION

910.5.1 GENERAL:

910.5.1.1 Pipe and appurtenances shall be new and unused. The type of pipe to be installed shall be as approved by these specifications or unless otherwise shown on the drawings. Pipe and appurtenances shall be handled in such a manner as to insure delivery to the trench in sound, undamaged condition. Particular care shall be taken to prevent damage to any pipe coating.

910.5.1.2 The interior of the pipe shall be thoroughly cleaned of foreign material before being lowered into the trench and shall be kept clean during construction operations. When work is not in progress, the open ends of pipe shall be securely closed so that no foreign materials will enter the pipe. Any section of pipe found to be defective before or after laying shall be replaced with sound pipe, or repaired in a manner satisfactory to the ENGINEER, without additional expense to the OWNER.

910.5.1.3 The CONTRACTOR shall install a plug in the new sewer at any point of connection to an existing system. The plug shall remain in place until the ENGINEER authorizes its removal in writing. The CONTRACTOR shall not flush or otherwise discharge any flow into an existing system unless approved in writing by the ENGINEER.

910.5.1.4 Pipe shall be laid to line and grade as shown on the plans and as staked in the field. The bottom of the trench shall be graded and prepared to provide a firm and uniform bearing throughout the entire length of the pipe barrel. Suitable excavation shall be made to receive the bell of the pipe and the joint shall not bear upon the bottom of the trench. All adjustment to the line and grade shall be made by scraping away or filling in with pipe zone material under the body of the pipe, and not by wedging or blocking. When connections are to be made to any existing manhole, pipe, or other improvement, the actual elevation or position of which cannot be determined without excavation, the CONTRACTOR shall excavate for and expose the existing improvement before laying the connecting pipe or conduit. When existing underground improvements may reasonably be expected to conflict with the line or

grade established for the new sewer line, the ENGINEER shall request and the CONTRACTOR shall excavate as necessary to expose and locate such potentially conflicting underground improvements prior to laying the new pipe. Any adjustment in line or grade which may be necessary to accomplish the intent of the plans will be made, and the CONTRACTOR will be paid for any additional work resulting from such change in line or grade in the manner provided for in the General Conditions.

910.5.1.5 CONTRACTOR shall submit to the ENGINEER the proposed method for making connections to existing manholes. Connection methods will be dependent upon manhole size and pipe sizes. Unnecessary damage to the existing manhole should be avoided.

910.5.1.6 Pipe shall be laid upgrade in a continuous operation from structure to structure, with the socket or collar ends of the pipe upgrade unless otherwise permitted by the ENGINEER. Concrete pipe with elliptical reinforcement shall be laid with the minor axis of the reinforcement cage in a vertical position. Corrugated metal pipe shall be laid with the external laps of the circumferential seams toward the inlet end.

## 910.6 JOINTS FOR PIPE

### 910.6.1 JOINT FOR CONCRETE PIPE:

910.6.1.1 The type of joint to be used shall be O-ring rubber gasket joints conforming to ASTM C 361 and C 443.

### 910.6.1.2 Gasketed Type of Joints for Reinforced Concrete Pipe

910.6.1.2.1 General--The ends of the pipe shall be so formed that when the pipes are laid together and joined, they shall make a continuous and uniform line of pipe with a smooth and regular surface.

910.6.1.2.2 Rubber gaskets for making compression-type joints for concrete pipe shall be factory fabricated in accordance with ASTM C 443; for pipes 12 inches in diameter and larger shall be O-ring and shall be handled, primed, installed, etc. in strict accordance with the manufacturer's recommendations.

910.6.1.2.3 The CONTRACTOR'S attention is particularly called to ASTM C 443, regarding storage of gaskets.

910.6.1.2.4 The CONTRACTOR shall furnish the ENGINEER complete information concerning the type

and make of all joint material which he intends to use under the contract, including certification that the joint material meets the requirements of the specifications.

### 910.6.2 JOINTS FOR CORRUGATED METAL PIPE:

910.6.2.1 The seams of the pipe are to be placed at the sides, not on the bottom. The inside circumferential seams should be placed pointing downstream. Care should be taken to insure that dirt or other particles do not get between the outside of the pipe and the pipe coupling. Paved inverts should be placed and centered on the bottom of the trench. Any damage to the protective lining and coating shall be repaired prior to the backfilling around the pipe.

910.6.2.2 If waterproof joints are called for on the plans or specified in the Supplementary Specifications, the caulking compound or other waterproofing material used shall be subjected to the approval of the ENGINEER.

## 910.7 TESTING FOR LEAKAGE

Normally storm sewer lines need not be tested, but if in the opinion of the ENGINEER, the workmanship or materials do not appear to be satisfactory, the ENGINEER may require that a section of the storm sewer line be tested in a similar manner as that for a sanitary sewer line, see Section 905.

## 910.8 CLEANING AND INSPECTION

910.8.1 CLEANING: No pipe spalls, rocks, dirt, joint compounds, cement mortar and other trash or obstructions shall be left in a sewer pipe of any size or type. During flushing operations the manhole outlet shall be bagged or plugged so that the debris will not be carried into an existing active line.

910.8.2 INSPECTION: Before lines become operational or final acceptance of the installation, small size lines shall be inspected by a television camera and larger size lines will be inspected by walking through the line.

910.8.3 TELEVISION: After the CONTRACTOR has cleaned and flushed the line, the CONTRACTOR will notify the ENGINEER that the line is ready for television inspection, if required. Prior to the television inspection (possibly during flushing operation) the CONTRACTOR will insert a 1/4-inch nylon rope in the line for the purpose of towing the television unit through the pipe. The OWNER will perform the first television inspection at no cost to the CONTRACTOR. If during the first inspection debris is found in the line, the television inspection will cease. When further

cleanup has been completed, the CONTRACTOR will request the ENGINEER to have a second inspection performed. The cost of the second inspection and any subsequent inspections of that segment of the line will be paid for by the CONTRACTOR at the rate of \$75.00 per hour while the television crew is at the line site.

## 910.9 MEASUREMENT AND PAYMENT

910.9.1 STORM SEWER PIPE: Installed pipe shall be measured and paid for as follows:

910.9.1.1 For straight lines the pipe length shall be the intervening distance between the centers of manholes along a line parallel to the pipe invert.

910.9.1.2 For curvilinear lines the pipe length shall be the intervening arc distance between the centers of manholes along a line parallel to the pipe invert.

910.9.1.3 For lateral lines, such as from main or manhole to a storm inlet, the pipe length shall be the distance between the center of a manhole or centerline of the main to the interior wall face of the storm inlet along a line parallel to the pipe invert.

910.9.1.4 Payment for pipe will be in accordance with the unit price per linear foot per size and material as defined in the Bid Proposal, and shall include pipe installed in the trench, jointing and coupling materials, and other materials necessary to connect to other sections of pipe, manholes, and other appurtenances.

910.9.2 REMOVAL AND DISPOSAL OF STORM SEWER PIPE: Removal and disposal of storm sewer pipe shall be measured by the linear foot within the specified pipe size increments. Payment will be made on the unit price per linear foot of specified pipe size in the Bid Proposal. Trenching, backfilling, and pavement removal and replacement will be paid for based on the unit prices for each appropriate bid item in the Bid Proposal. If new pipe is to be installed in the same trench as the removed pipe, only one payment will be made for trenching, backfilling, and pavement removal and replacement.

910.9.3 TESTING OF PIPE: No payment will be made for required initial or subsequent tests on sections of the storm sewer line.

## SECTION 920

### SANITARY AND STORM SEWER MANHOLES

#### 920.1 GENERAL

This section contains items which are relative to the installation of sanitary and storm sewer manholes.

#### 920.2 REFERENCES

##### 920.2.1 ASTM

C 43	C 497
C 139	C 1557
C 478	

##### 920.2.2 This publication

SECTION 101	SECTION 106
SECTION 102	SECTION 161
SECTION 105	

#### 920.3 MANHOLE MATERIALS

Sewer manhole materials shall be as specified in other sections, as follows:

Portland Cement Concrete	Section 101
Steel Reinforcing	Section 102
Concrete Curing Compound	Section 105
Cement Mortar and Grout	Section 106
Gray Iron Castings	Section 161

#### 920.4 MANHOLE CONSTRUCTION

##### 920.4.1 GENERAL:

920.4.1.1 Soil Foundations for manhole base shall be compacted to a density of 95 percent of the maximum density per ASTM D 1557. Compaction limits shall be one foot beyond the perimeter of the concrete base and shall be a minimum of one foot in depth.

920.4.1.2 Manholes shall be constructed in accordance with the Standard Detail Drawings and as shown on the construction plans. Precast reinforced concrete units, concrete blocks or formed in place, reinforced concrete may be used to construct the manhole.

920.4.1.3 Invert elevation of the pipes entering or exiting the manhole and interior inverts shall not vary more than 0.05 foot from the elevations indicated on the construction plans.

920.4.1.4 All cement used for poured foundations. Mortar, fillets, grout, and concrete shelf construction shall be Type II or approved equal.

920.4.1.5 All concrete for formed in place foundations or bases, concrete shelves, and pipe supports shall be 3000 psi compressive strength concrete.

920.4.1.6 Depending on the size of the pipe, connections to existing and new manholes shall be made by either core drilling through the manhole wall, pre-formed for new precast units, or for large-size pipe the manhole wall may be removed by carefully chipping the wall segment which will permit entry of the pipe. In the latter operation, exposed manhole reinforcement should be bent and tied to the reinforcement of the pipe collar. If core drilling is not practical, the CONTRACTOR shall request the ENGINEER to authorize the chipping operation. During either operation the CONTRACTOR shall take care to avoid unnecessary damage to the manhole surfaces or walls.

##### 920.4.2 PRECAST CONCRETE MANHOLES:

920.4.2.1 The vertical sections of the manhole may be of different dimensions in order that manholes of various depths can be readily assembled.

920.4.2.2 Concrete, used for precast bases, vertical sections, and eccentric cones, shall be 4000 psi compressive strength concrete.

920.4.2.3 Vertical sections of the manhole shall conform to the requirements of ASTM C 478.

920.4.2.4 The CONTRACTOR shall submit shop drawings of the precast base and eccentric cone to the ENGINEER for review and approval.

920.4.2.5 Circular precast manhole sections shall be provided with mastic gasket to seal joints between sections, such as RAM-NEK, KENT SEAL, or approved equal.

920.4.2.6 All lifting holes, except Type "C" manhole covers, and gaps at joints shall be filled with a nonshrink grout.

920.4.2.7 Precast concrete manhole bases may be used when approved by the ENGINEER. If approved, it shall be with the understanding that the CONTRACTOR shall be responsible for placing the bases at the specified elevation, location, and alignment.



#### 920.4.3 FORMED INPLACE REINFORCED CONCRETE MANHOLE:

920.4.3.1 The CONTRACTOR shall submit preconstruction drawings of the proposed manholes to the ENGINEER for review and approval.

920.4.3.2 Concrete used for this type of manhole construction shall be 4000 psi compressive strength concrete.

920.4.3.3 If desired, a precast eccentric cone or a flat cover can be used.

#### 920.4.4 CONCRETE BLOCK MANHOLE:

920.4.4.1 The CONTRACTOR shall submit preconstruction drawings of the proposed manhole to the ENGINEER for review and approval.

920.4.4.2 Concrete masonry units for the construction of this type of manhole shall conform to ASTM C 139 and the Standard Detail Drawings. All blocks shall be mortared into place.

920.4.4.3 Eccentric cone or flat-type cover shall be used.

#### 920.4.5 TEE PIPE MANHOLE:

920.4.5.1 Tee pipe manholes will be used for all 4-foot-diameter mainline pipes and larger. Horizontal section of the tee pipe shall be the same class of pipe as the adjacent sections. The vertical sections shall comply with the requirements set forth in ASTM C 478.

920.4.5.2 Top of the vertical portion of tee pipe unit will extend a minimum of 18 inches above the outside diameter of the horizontal pipe. The 4-foot-diameter vertical section of the tee pipe shall be connected at the longitudinal center point of the horizontal pipe section. The minimum length of horizontal pipe section shall be 8 feet.

920.4.5.3 The CONTRACTOR shall submit to the ENGINEER for review and approval preconstruction shop drawings on the fabrication of the tee pipe section as developed by a precast reinforced concrete pipe manufacturer. Field fabrication of this eccentric pipe unit will not be accepted. Shop drawings for the eccentric cone will also be submitted for review and approval.

920.4.5.4 RAM-NEK, Kent Seal, or OWNER - approved equal sealants shall be used to seal the joints in the vertical portion of this manhole.

920.4.5.5 All lifting holes, except for Type "C" manhole covers, and gaps at joints shall be filled with a nonshrink grout.

920.4.5.6 Standard Detail Drawings show some of the components of the tee-type pipe manhole.

#### 920.4.6 COATING OF MANHOLES:

920.4.6.1 Exterior of Manholes: Exterior coating of manholes shall be required in areas where ground water is present. The coating shall be a waterproofing type of bitumastic or asphaltic material, as approved by the ENGINEER. Application shall be in accordance with the manufacturer's published recommendations.

920.4.6.2 Interior of Manholes: Interior coating of manholes shall be required only when specified on the construction plans. The coating shall be an epoxy resin-type material, be an epoxy resin-type material such as: "Zebtron," "Plastite 7122," or approved equal, and shall be capable of protecting the concrete from deterioration due to a gaseous environment. Application shall be in accordance with the manufacturer's published recommendations.

920.4.6.3 Plastering of Manholes: The work shall include the coating of the surface of existing block manholes with plaster as required on the plans.

#### 920.4.7 MANHOLE STEPS:

920.4.7.1 Manhole steps shall be 1/2" diameter, grade 60, reinforcing rod completely encapsulated in copolymer polypropylene or corrosion resistant rubber compound. Steps shall be designed to be cast in place or hammered into holes in manhole walls.

920.4.7.2 Approved manhole steps of only one manufacturer model shall be used on any specific project and shall not be intermixed with other approved steps. Approved steps must bear the manufacturer name and model on the exposed surface of the step and shall be one of the following products or approved equals: M.A. Industries, Inc. - Model PS-2-PFS H. Bowen Co.-Bowco, Model 81213 or 93813 Delta Pipe Products -WEDG-LOK, Model W-II

920.4.7.3 The minimum width of step tread shall be 11 inches. Steps will be spaced uniformly in each manhole. Spacing may be between 12 inches to 16 inches on center. Lower step will be 12 inches above manhole shelf or top of main. The upper step shall be 6 inches below the top portion of the eccentric cone or 6 inches below the bottom of the flat cover.

Also the steps shall be aligned vertically with the opening of the cone or cover.

920.4.7.4 Steps shall be embedded in the manhole wall a minimum of 3" inches and protrude from the manhole interior surface a minimum of 4 3/4 inches.

920.4.7.5 Holes for step installation shall be drilled or precast per manufacturer's recommended size. or of sufficient size to allow for step insertion into the wall. Cast-in-place sockets or tapered holes recommended by the step manufacturer may be used with prior approval of ENGINEER. If the hole has been drilled too large, then the step shall be secured in place by using epoxy grout for the full depth of the drilled hole.

920.4.6 Acceptable manhole step installations must be capable of withstanding a 400 pound. horizontal, pull out load applied in accordance with ASTM C-497.

#### 920.4.8 ADJUSTMENT BRICKS:

920.4.8.1 Manhole adjustment bricks shall conform to the requirements for manhole bricks. per ASTM C 32 for Grade MS.

920.4.8.2 Mortar shall be used to lay the bricks. as well as coating the interior and exterior surfaces of the laid brick. Thickness of the mortar coating shall be 1/2 inch.

#### 920.4.9 MANHOLE FRAME AND COVER:

The manhole frame and cover for either the sanitary or storm sewer manholes shall conform to the specifications contained in Section 161.

#### 920.5 TESTING OF SEWER MANHOLES:

920.5.1 All sanitary sewer manholes shall be tested for leakage by either a water exfiltration test or a vacuum test. Whichever test is utilized it is recommended that the test be performed prior to backfilling around the manhole and prior to placement of the manhole frame and cover. All inlet and outlet lines shall be properly plugged and the lift holes and barrel joints filled and sealed as specified. The CONTRACTOR shall be responsible for all materials and equipment necessary to perform the test and shall conduct the test in the presence of the ENGINEER or his representative. The CONTRACTOR has the option of performing a manhole test in increments appropriate to the depth of the manhole.

920.5.2 The water exfiltration test shall consist of filling the entire manhole with water to the bottom of

the frame elevation. A stabilization period of one hour will be allowed for absorption. After which the manhole shall be refilled as necessary before starting the test. The test period shall be two (2) hours. After which the manhole shall be refilled, measuring the necessary quantity of water. The allowable leakage shall be 0.25 gallons per foot diameter per vertical foot per day, and is represented by the following formula:

$$V = 0.25 \text{ DHT}/24$$

where; V = Allowable loss in gallons

D = Manhole diameter in feet

H = Initial depth of water to invert in feet

T = Duration of test in hours

920.5.3 The vacuum test shall consist of utilizing an inflatable compression band, vacuum pump, gauges and appurtenances specifically designed for vacuum testing. Test procedures shall be in accordance with the manufacturer's printed recommendations. The ENGINEER shall be the sole judge as to the adequacy of the equipment.

920.5.3.1 A vacuum of 10" Hg shall be placed in the manhole and the time measured for a drop to 8.5" Hg. The test shall be considered to be successful if the measured time exceeds the test period. Should the test fail, the manhole shall be repaired as necessary and the test rerun. The test periods are:

920.5.3.2 Sixty (60) seconds for four (4) foot diameter manholes.

920.5.3.3 Seventy-five (75) seconds for five (5) foot diameter manholes.

920.5.3.4 Ninety (90) seconds for six (6) foot diameter manholes.

920.5.3.5 One hundred and Twenty (120) seconds for eight (8) foot diameter manholes.

920.5.4 Normally storm sewer manholes need not be tested unless specifically required by the project plans or supplemental technical specifications. However, if in the opinion of the ENGINEER, the workmanship or materials do not appear to be satisfactory, the ENGINEER may require that any storm sewer manhole be tested in a similar manner as that for a sanitary sewer manhole.

#### 920.6 ABANDONMENT OF MANHOLES

920.6.1 Abandonment of manhole, which is part of a sewer line being abandoned, shall entail the following work and materials:

920.6.2 Manhole will not be removed but will be abandoned in place.

920.6.3 All manhole inlet and outlet lines shall be plugged with a 12-inch- thick concrete or concrete mortar plug.

920.6.4 Salvageable material shall be stockpiled on the job site. The CONTRACTOR shall contact the OWNER to arrange for a representative to inspect the materials for usability. Salvageable materials shall be transported by the CONTRACTOR as directed by the OWNER. CONTRACTOR will receive a receipt for the turned-in materials. Receipts will be submitted to the ENGINEER prior to final acceptance of the Project. Unusable materials will be disposed of by the CONTRACTOR.

920.6.5 Manhole bottom will be pulverized.

920.6.6 The manhole shall be filled with cement treated base (CTB) material to the bottom elevation of the asphalt base course of the pavement or to the ground surface level.

920.6.7 All labor, materials, and equipment necessary to complete this work shall be furnished by the CONTRACTOR.

920.6.8 For historical information the ENGINEER shall have a survey performed which will locate the abandoned manhole, relative to permanent survey markers.

#### 920.7 SEWER MANHOLE REHABILITATION IN REPLACEMENT WORK

920.7.1 The work under this item shall be to replace the existing manhole frame and cover and to place a concrete pad around the existing manhole as required per the construction plans. This work will be done only when an existing man- hole is encountered in the normal course of the replacement work that has a light- weight, vented, multi-holed manhole cover.

920.7.2 The work and materials shall include the following:

920.7.2.1 Remove any and all existing brick under frame and replace with new Grade MS brick as necessary to bring new frame and cover up to street grade.

920.7.2.2 Remove and replace existing concrete pad, or construct a new pad.

920.7.2.3 Remove existing steps and replace with new steps or, if steps are nonexistent, install new steps. Steps will be installed as per Subsection 815.4.7.

920.7.2.4 Remove and replace pavement.

920.7.2.5 Excavation and compaction of backfill as necessary.

920.7.2.6 All materials, labor, and equipment necessary to do the work under this item shall be furnished by the CONTRACTOR.

920.7.2.7 The work and materials under this item shall be done according to the manner set forth in the Standard Detail Drawings and other sections of these specifications.

920.7.3 Salvageable material shall be stockpiled on the job site. The CONTRACTOR shall contact the OWNER to arrange for a representative to inspect the materials for usability. Salvageable materials shall be transported by the CONTRACTOR as directed by OWNER. CONTRACTOR will receive a receipt for the turned-in materials. Receipts will be submitted to the ENGINEER prior to final acceptance of the Project. Unusable materials will be disposed of by the CONTRACTOR.

#### 920.8 MEASUREMENT AND PAYMENT

##### 920.8.1 NEW MANHOLES:

920.8.1.1 Type "C," "E," "F," or "G" manholes of 4-foot or 6-foot diameters shall be measured per each within the following increments of depth: 3 to 6 feet, 6 to 10 feet, and 10 to 14 feet. Manholes which are greater in depth than 1 foot shall be measured by the vertical foot. Measurements will be made to the nearest foot and will be from the manhole rim elevation to the manhole invert elevation.

920.8.1.2 Payment for manholes 14 feet deep or less will be made on the unit price per manhole diameter per depth increment as specified in the Bid Proposal. Payment for manhole depths which exceed 14 feet will be made on the unit price per manhole diameter per vertical foot. This payment is in addition to the manhole unit price for the portion above the 14 foot depth.

920.8.1.3 Type "A" or Tee-type manholes shall be measured and paid for by the methods described in 920.8.1.1 and 920.8.1.2. Measurement will be from the invert of the main line to the manhole rim. Payment under this item will include the normal manhole costs described below, as well as any additional pipe costs for the precast tee and for the concrete cradle under the tee.

920.8.1.4 Payment for any type diameter or depth of manhole will include excavation, compacted backfilling, shelving, cover or cone, leveling bricks, frame and cover, and concrete pad or collar.

## 920.8.2 ELEVATION ADJUSTMENTS:

920.8.2.1 When a new manhole is installed, no measurement or payment will be made for rim elevation adjustments to conform to street surface grades.

920.8.2.2 The following measurements and payments for rim elevation adjustments on existing manholes will be made for indicated conditions:

920.8.2.2.1 Unit price per inch of adjustment ring for adjustment to manhole frame by the addition of adjustment ring.

920.8.2.2.2 Unit price per inch of leveling brick adjustment.

920.8.2.2.3 Unit price per manhole diameter per vertical foot of adjustment to cone and/or barrel.

920.8.2.3 As required, the following items will be included in the unit price per appropriate adjustment: pavement removal and replacement, excavation, compacted backfilling, concrete collar or pad, leveling bricks, adjusting rings, and/or frame and cover.

920.8.3 COATING OF MANHOLE: Plastering or epoxy coating for manholes shall be measured and paid for on the unit price per square foot of surface area covered.

920.8.4 MANHOLE STEPS: Unless otherwise shown on the Bid Proposal, the cost of manhole steps shall be incidental to the unit prices for construction of manholes of various types and depths.

920.8.5 ABANDONMENT OF MANHOLES: Measurement and payment for abandonment of a manhole shall be the unit price per manhole for defined work in Subsection 920.6.

920.8.6 MANHOLE REHABILITATION IN REPLACEMENT WORK: Work under this item shall be measured and paid for by the unit price per manhole for work specified in the Bid Proposal.



920.8.7 TESTING: There will be no payment for required testing of sewer manholes.

**GENERAL NOTES:**

1. TYPE E M.H. NOT TO BE USED FOR DEPTHS LESS THAN 6' MEASURED FROM INV. TO RIM.
2. M.H. GREATER THAN 18' IN DEPTH SHALL BE OF PRECAST CONC. SECTIONS ONLY.
3. DESIGN APPLIES TO 4' AND 6' I.D. MANHOLES.
4. USE NON-SHRINK GROUT FOR JOINTS, FILLETS & PIPE PENETRATIONS.
5. COMPACT ALL BACKFILL AROUND M.H. TO 95%.
6. POSITION M.H. OPENING OVER THE UPSTREAM SIDE OF MAIN LINE.





**CONSTRUCTION NOTES:**

- A. CONCRETE PIPE SUPPORTS SHALL EXTEND OUTSIDE OF M.H. TO BELL OF FIRST JOINT AND SHALL CRADLE PIPE TO SPRING LINE.
- B. PIPE PENETRATION INTO MANHOLE SHALL BE FLUSH TO 2" MAX., MEASURED AT SPRINGLINE OF PIPE.
- E. USE MAX. 4 COURSES GR. MS BRICK ON UNPAVED STREET FOR FUTURE ADJ. OF FRAME TO PAVEMENT GRADE. PLASTER INSIDE WITH 1/2" MORTAR.
- F. BASE TO BE POURED IN PLACE USING NO. 4 BARS AT 6" O.C. EA. WAY FOR M.H. DEPTH OF 16' OR GREATER. NO. 4 BARS AT 12" O.C. EA. WAY FOR M.H. LESS THAN 16' DEEP.
- H. INV. ELEV. OF STUB OR LATERAL AS SHOWN ON PLANS.
- J. 6" GROUT FILLET ON UPPER HALF OF PIPE AND AROUND BASE.
- K. USE A 5' X 5' CONCRETE PAD IN ALL AREAS.
- L. M.H. FRAME AND COVER, SEE DWG. 2110.
- M. CONCRETE FILL, 3000 PSI.
- N. SLOPE 1" PER FT. FROM PIPE CROWN.
- P. SHELF TO BE 9" WIDE MIN.
- Q. APPROVED WATERSTOP TO BE WITH TYPE OF PIPE.
- R. STEPS TO BE INSTALLED AS PER SPEC. SECTION 920.4.7.
- S. END (IN UNPAVED AREAS).
- T. IN UNPAVED AREAS SET FRAME TO GRADE AND SLOPE TOP OF PAD.

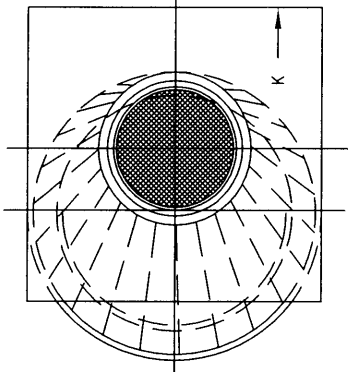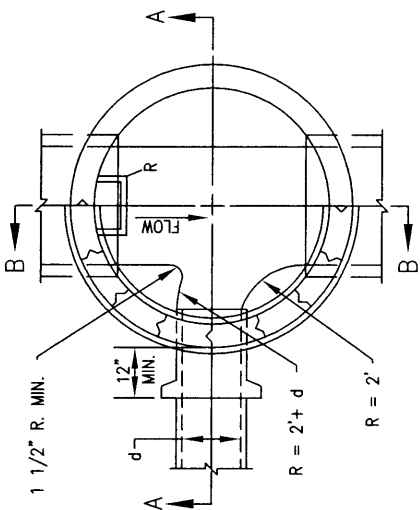

PLAN AT C-C

PLAN AT D-D

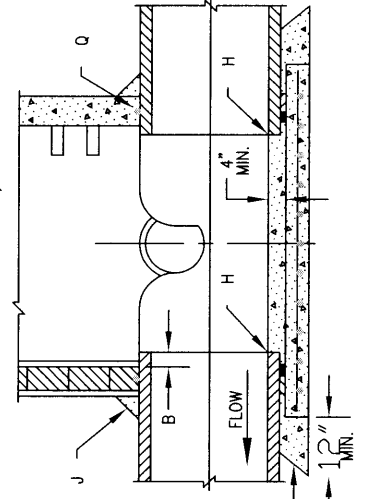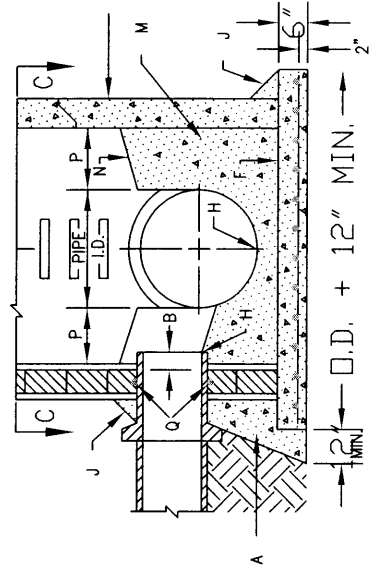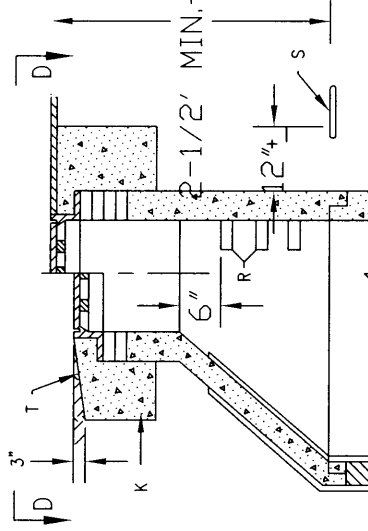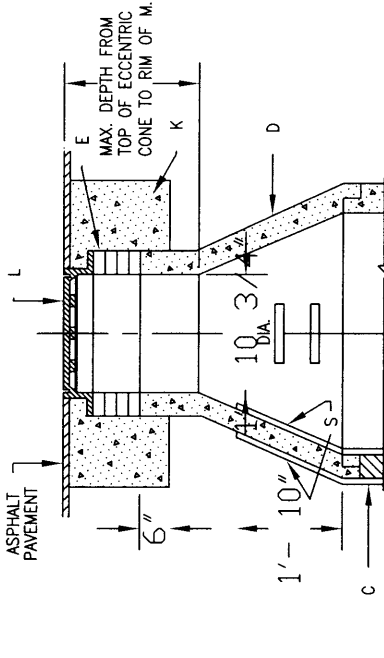

CROSS SECTION A-A

CROSS SECTION B-B

REVISIONS

NM APWA  
SEWER  
MANHOLE TYPE "E"

DWG. 2102



FEB. 2006

GENERAL NOTES :

1. FOR SINGLE GRATE TYPE STORM INLET DELETE CENTER SUPPORT AND MOVE ONE END WALL TO FORM NEW SINGLE GRATE INLET.
2. FOR STORM INLET GUTTER TRANSITION, SEE DWG. 2207.
3. OUTLET PIPE SIZE, PER DESIGN REQUIREMENT.
4. FOR FRAME & GRATING, SEE DWG. 2216, 2220 & 2221.
5. FOR CENTER SUPPORT ASSEMBLY, SEE DETAIL.
6. FOR CENTER SUPPORT ASSEMBLY, SEE DWG. 2215.

CONSTRUCTION NOTES :

- A. GUTTER TRANSITION.
- B. TOP OF CURB.
- C. CENTER SUPPORT ASSEMBLY.
- D. FLOWLINE.
- E. CONSTRUCTION JOINT.
- F. NORMAL GUTTER LINE.
- G. 1'-10" MIN., UNLESS OTHERWISE DIRECTED.
- H. FRAME AND GRATE.
- J. INVERT OF OUTLET PIPE.
- K. CONCRETE FILL, MINIMUM SLOPES AS SHOWN.
- L. FOR STORM INLET DEPTHS GREATER THAN 4' INSTALL STD STEPS, SEE DWG. 2229, DOWNSTREAM FACE.
- M. EXTEND NO. 4 REBARS 18" INTO CURB ON EACH SIDE OF STORM INLET.
- N. NO. 4 BARS AT 6" O.C.
- P. 3 1/2" X 3 1/2" X 1/2" X 1/2" X 4' - 0" FOR SINGLE GRATE TYPE "C" STORM INLET.
- Q. 3 1/2" X 3 1/2" X 1/2" X 1/2" X 7' - 6" FOR DOUBLE GRATE TYPE "C" STORM INLET.
- R. ANCHOR.

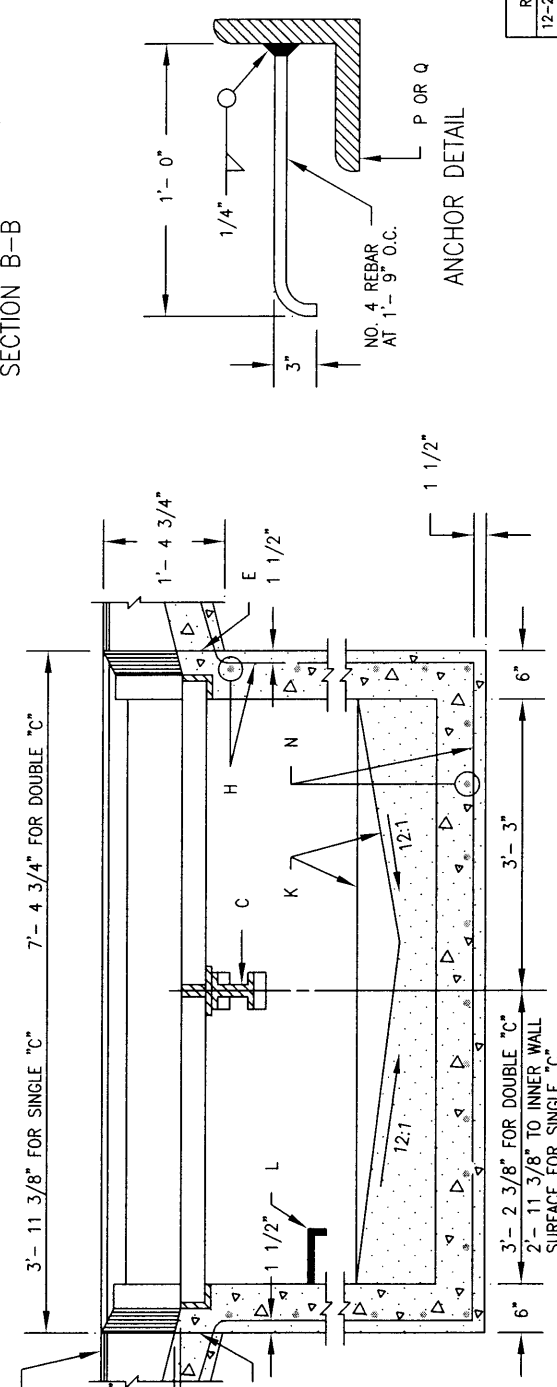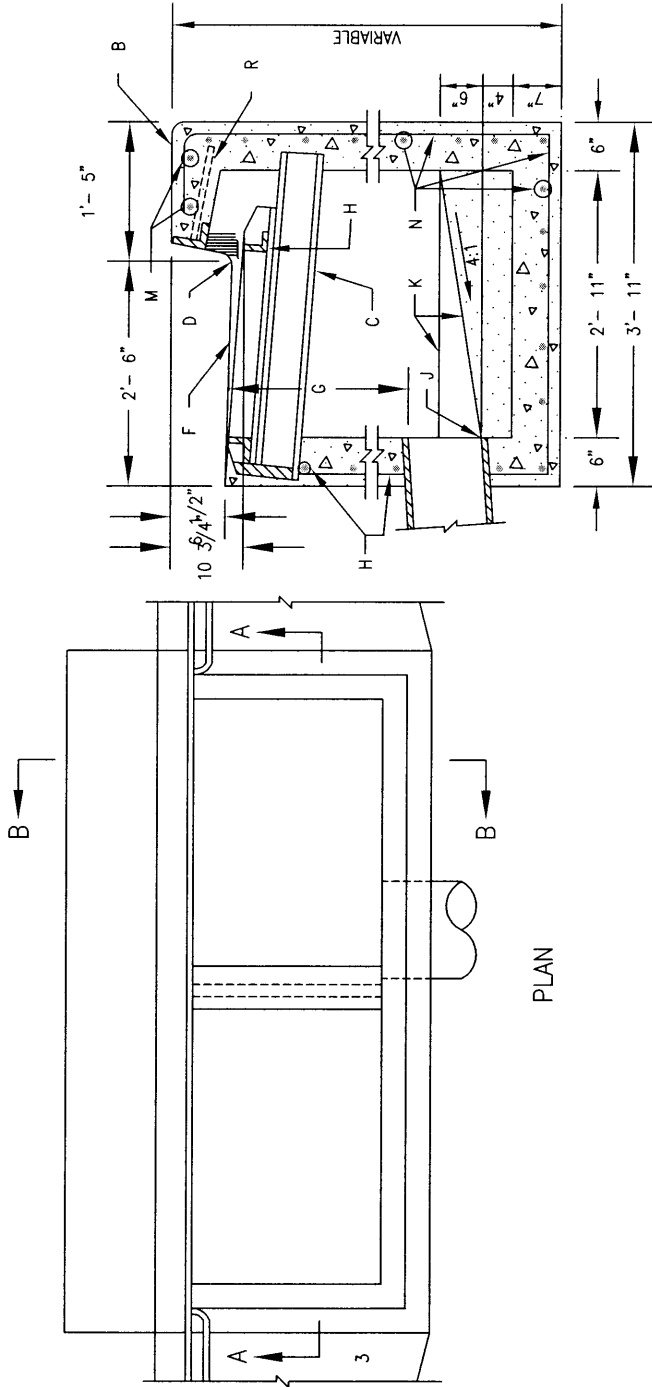

REVISIONS
12-21-92

NM APWA

DRAINAGE  
STORM INLET DOUBLE "C"

DWG. 2205

FEB. 2006



## SUPPLEMENTAL SPECIFICATION 1504

### NPDES COMPLIANCE

*Revised 08/21/2020*

#### 1504.1 SCOPE OF WORK

The work under this section includes compliance with the U.S. Environmental Protection Agency (EPA), National Pollutant Discharge Elimination System (NPDES) Regulations for Storm Water Discharges from construction sites. This work consists of implementing and maintaining a plan to control erosion, pollution, sediment and runoff during the construction of the project.

#### 1504.2 MEASUREMENT AND PAYMENT

##### 1504.2.1 UNIT PRICE BID PROPOSALS

For Unit Price Bid Proposals, NPDES Compliance shall be a Lump Sum (LS) item, paid for as follows:

1504.2.1.1 Fifteen (15) percent of the Lump Sum unit price amount shall be paid after the Contractor has completed an EPA Notice of Intent (NOI) for Storm Water Discharges Associated with Construction Activity Under a NPDES General Permit, Form 3510-9, or a Low Erosivity Waiver (LEW) form, if applicable. A copy of the NOI or LEW form must be delivered to the Owner and the original filed with the EPA. All required erosion control measures sufficient to begin construction must also be in place. This will be defined in the plan specifications and/or the SWPPP.

1504.2.1.2 Payment for an additional sixty percent (60%) of the Lump Sum unit price amount shall be prorated based on the Actual Percent Complete on the Application for Payment as approved by the Architect, Engineer or Landscape Architect. For example, if the Contractor is 20% complete, the contractor can take the 20% (0.2) and multiply it by 60% (0.6) of the Lump Sum unit price amount and receive that portion.

**In order to receive payments, the field inspection forms must be sent in with the Application for Payment each month.** If there are deficiencies maintaining or implementing the SWPPP and its Best Management Practices (BMPs), the payment will be withheld until the deficiencies are corrected.



1504.2.1.3 The remaining twenty-five (25) percent of the Lump Sum unit price amount will be based on the completion of an EPA Notice of Termination (NOT) of Coverage Under a NPDES General Permit for Storm Water Discharges Associated with Construction Activity and BMP removal. A copy of the NOT must be delivered to the Owner and the original filed with the EPA. BMPs must be removed as defined in the plan specifications or SWPPP. This is done in case there are some BMPs that must remain until final stabilization is met, and that there are no more NPDES concerns for the Contractor.

**END OF SECTION**